



GROOVE JOINT IN SIDEWALK

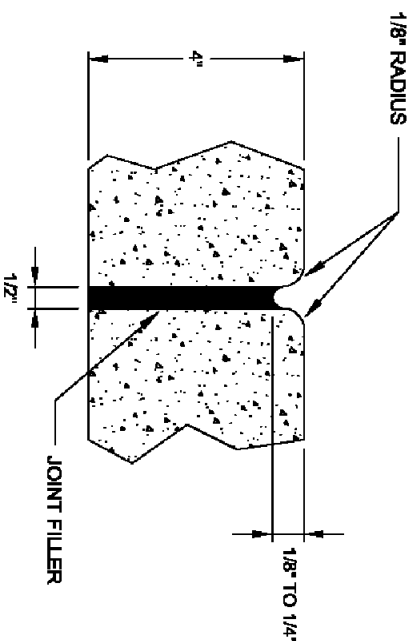


TRANSVERSE EXPANSION JOINT IN SIDEWALK

- GENERAL NOTES:**
1. A GROOVE JOINT 1" DEEP WITH 1/8" RADIUS SHALL BE REQUIRED IN THE CONCRETE SIDEWALK AT 5' INTERVALS. ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT 45' INTERVALS NOT TO EXCEED 50' AND MATCHING EXPANSION/CONSTRUCTION JOINT IN ADJACENT CURB. A SEALED 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.
 2. SIDEWALK AT DRIVEWAY ENTRANCES TO BE 6" THICK.
 3. WIDTH OF SIDEWALK ON ALL STREETS SHALL BE A MINIMUM OF 5'.
 4. CONCRETE COMPRESSIVE STRENGTH SHALL BE 3600 PSI. IN 28 DAYS.
 5. ZONING CONDITIONS MAY REQUIRE ADDITIONAL WIDTH SIDEWALKS WHICH SHALL SUPERSEDE THESE STANDARD DIMENSIONS SHOWN.

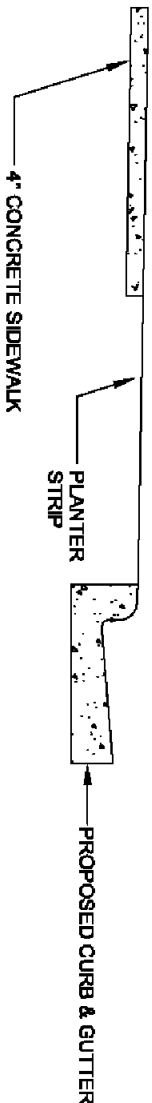

CONCRETE SIDEWALK WITH PLANTER STRIP

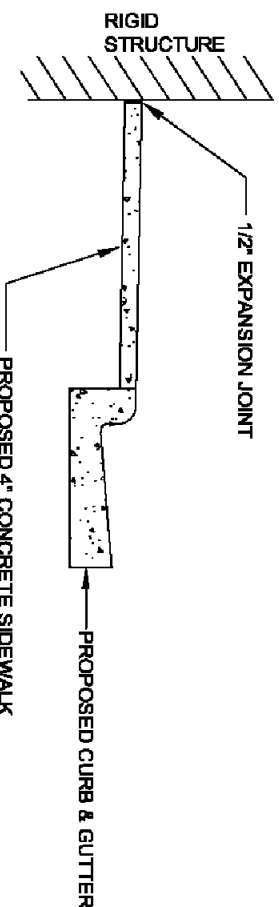

DETAILS SHOWING EXPANSION JOINTS

FOR CONCRETE SIDEWALK

TOWN OF
MARSHVILLE, NC

CONCRETE SIDEWALK

STD.
3.01

REVISIONS

NO DATE BY COMMENT
